




FOURTH FLOOR PLAN

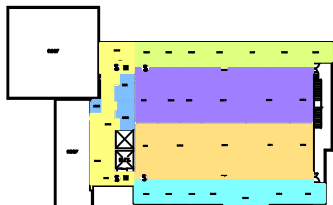


FOURTH FLOOR PLAN

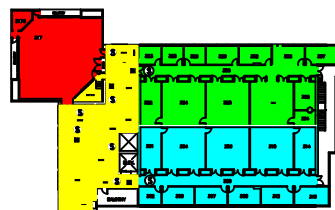


THIRD FLOOR PLAN

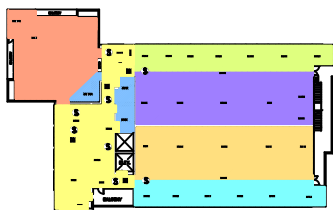


THIRD FLOOR PLAN

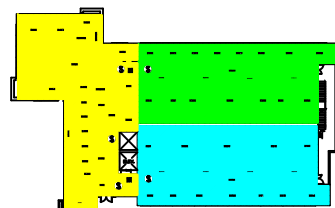


SECOND FLOOR PLAN

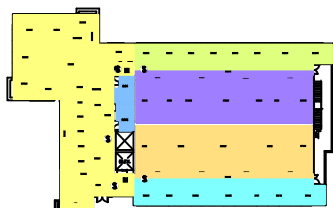

SECOND FLOOR PLAN



FIRST FLOOR PLAN




FIRST FLOOR PLAN

SUPPLY AIR ZONES AND
SMOKE DETECTION PLAN


EXHAUST ZONES AND
SMOKE DETECTION PLAN

LEGEND:


- AHU-01-SB
- AHU-02-SB
- AHU-03-SB
- AHU-04-SB
- BL-02-SB
- BL-47-SB
- BL-48-SB
- BL-S2-SB
- (WAS BL-4-48)
- (WAS BL-5-48)
- WEST LABS
(MULTIPLE BLOWERS)
- EAST LABS
(MULTIPLE BLOWERS)
- SD SMOKE DETECTOR
- SD DUCT SMOKE DETECTOR
- DOOR HOLDER
- FPCP FIRE PROTECTION CONTROL PANEL

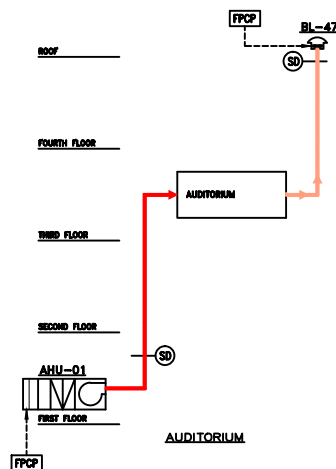


AUDITORIUM

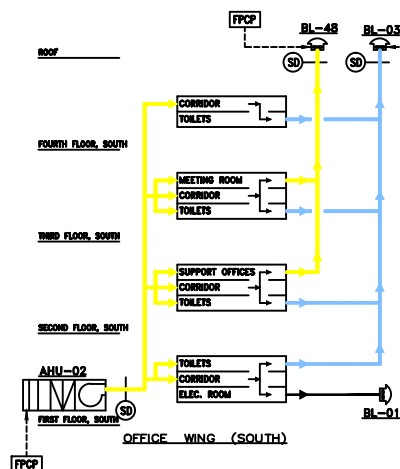

OFFICE WING (SOUTH)

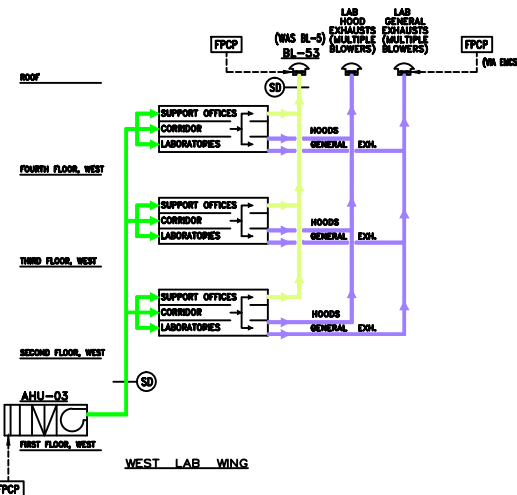

WEST LAB WING

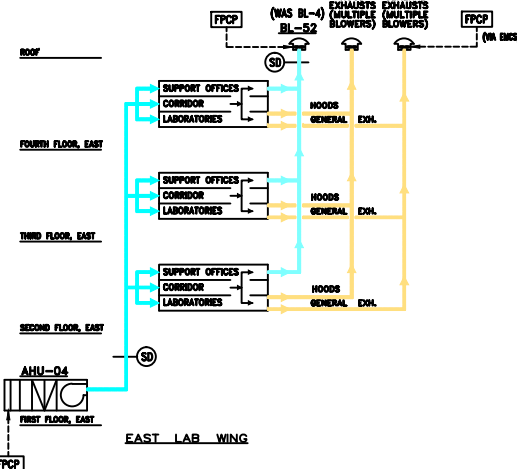

EAST LAB WING

SUPPLY & EXHAUST
FLOW DIAGRAM

NOTE:

- ANY WATER FLOW, FIRE CALL BOX, DUCT DETECTOR OR SMOKE DETECTOR IN ALARM WILL:
- 1. SHUT DOWN ALL AHU'S AND CLOSE DAMPERS.
- 2. ACTIVATE DOOR CLOSERS ON ALL FLOORS.
- 3. START BL-3, BL-47, BL-48, BL-S2 AND BL-S3.